



Απόσταση μειγμάτων χλωροφορμίου - μεθανόλης

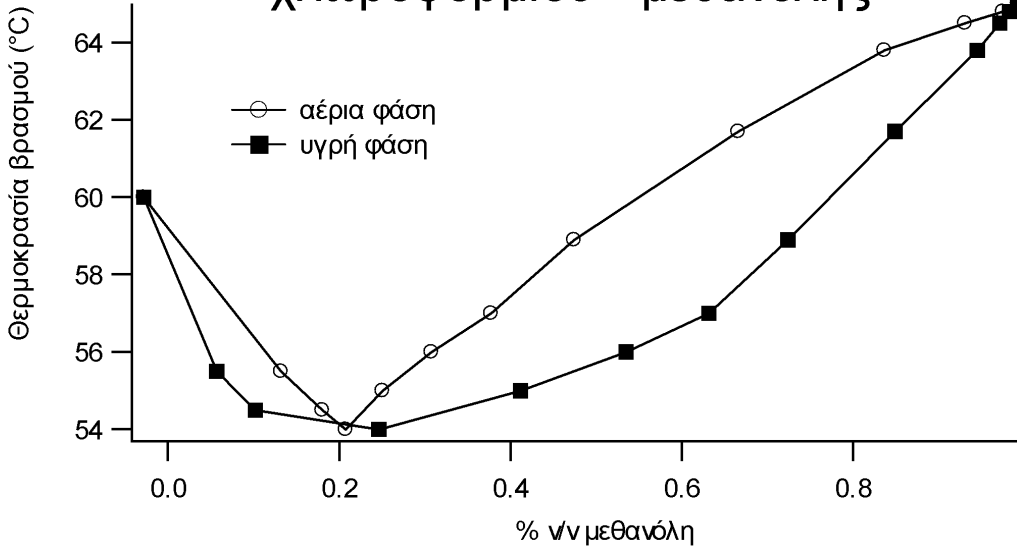

α/α	Θερμοκρασία (°C)	δ.δ. (υγρού)	δ.δ. (αερίου)	% A (υγρού)	% A (αερίου)
0	65.0	1.3261	1.3261	0.992	0.992
1	64.8	1.3272	1.3281	0.983	0.975
2	64.5	1.3285	1.3331	0.971	0.931
3	63.8	1.3315	1.3438	0.945	0.837
4	61.7	1.3424	1.3632	0.849	0.666
5	58.9	1.3566	1.3850	0.724	0.474
6	57.0	1.3671	1.3960	0.632	0.377
7	56.0	1.3781	1.4039	0.535	0.308
8	55.0	1.3921	1.4104	0.412	0.251
9	54.0	1.4109	1.4153	0.246	0.207
10	54.5	1.4273	1.4184	0.102	0.180
11	55.5	1.4324	1.4239	0.057	0.132
12	60.0	1.4421	1.4421	-0.028	-0.028

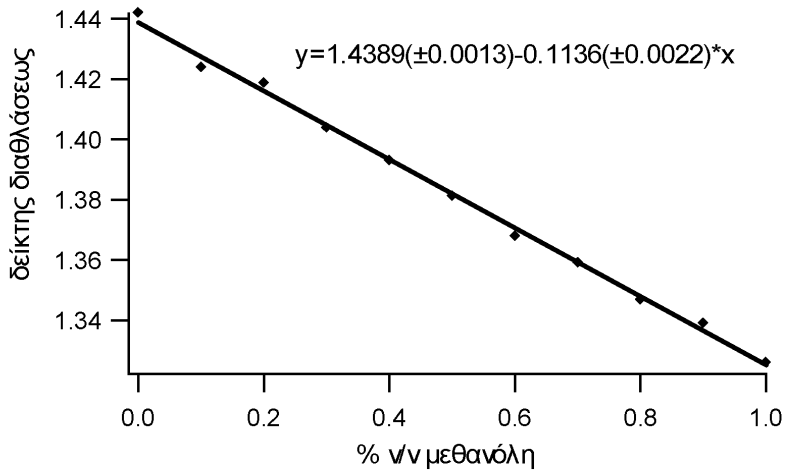

α/α	% v/v	δ.δ.
0	0.0	1.4421
1	0.1	1.4240
2	0.2	1.4188
3	0.3	1.4040
4	0.4	1.3931
5	0.5	1.3813
6	0.6	1.3680
7	0.7	1.3592
8	0.8	1.3469
9	0.9	1.3391
10	1.0	1.3261

Φρόσω Σιάμου, Ελένη Γκίνη
Μετρήσεις: 2/5/2001
Επεξεργασία: 30/5/2001